


Southwest Washington Chapter of ICC

This construction detail is accepted as meeting the minimum standard of construction as based upon the 2003 IRC requirements and is accepted in the following regional jurisdictions

Clark County, Cowlitz County, Skamania County, City of Camas, City of Centralia, City of Kalama, City of Longview, City of Ridgefield, City of Vancouver, City of Washougal, City of Woodland

◀ stud width ▶

UBC SECTION 2320.11.9 & 2320.11.10

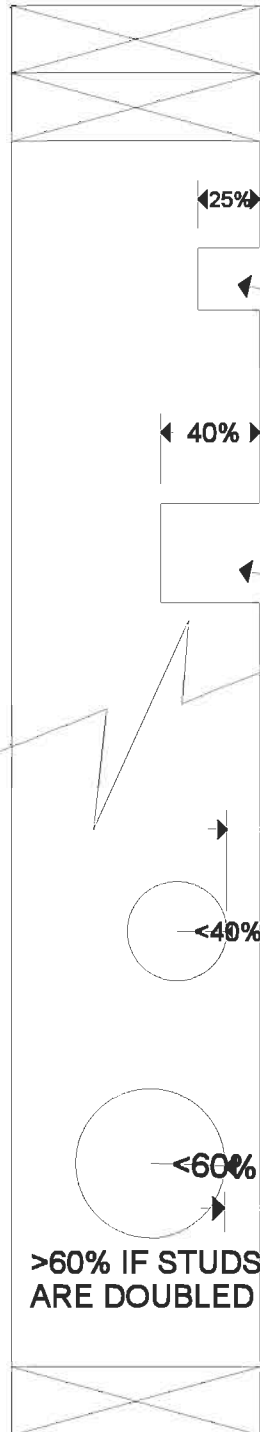

IN EXTERIOR WALLS AND BEARING WALLS, ANY WOOD STUD MAY BE CUT OR NOTCHED TO A DEPTH NOT EXCEEDING 25% OF ITS WIDTH

IN NON-BEARING PARTITIONS SUPPORTING NO LOADS OTHER THAN THE WEIGHT OF THE PARTITION, CUTTING OR NOTCHING IS ALLOWED TO A DEPTH NOT GREATER THAN 40% OF THE WIDTH OF THE STUD

A HOLE NOT GREATER THAN 40% OF THE WIDTH MAY BE BORED INTO ANY STUD
HOLES UP TO 60% OF THE WIDTH MAY BE BORED IN NONBEARING PARTITIONS OR IN ANY WALL WHERE EACH BORED STUD IS DOUBLED, PROVIDED NOT MORE THAN TWO SUCH SUCCESSIVE DOUBLED STUDS ARE BORED.
IN NO CASE SHALL THE EDGE OF THE BORED HOLE BE NEARER THAN 5/8 INCH TO THE EDGE OF THE STUD.
BORED HOLES SHALL NOT BE LOCATED IN THE SAME SECTION OF STUD AS A CUT OR NOTCH.

#13 1/1/00

NOTCHING & BORING OF STUDS

DWG BY LGN