


## M1804.2.6 Mechanical draft systems

Mechanical draft systems shall be installed in accordance with their listing, the manufacturer's installation instructions and, except for direct vent appliances, the following requirements:

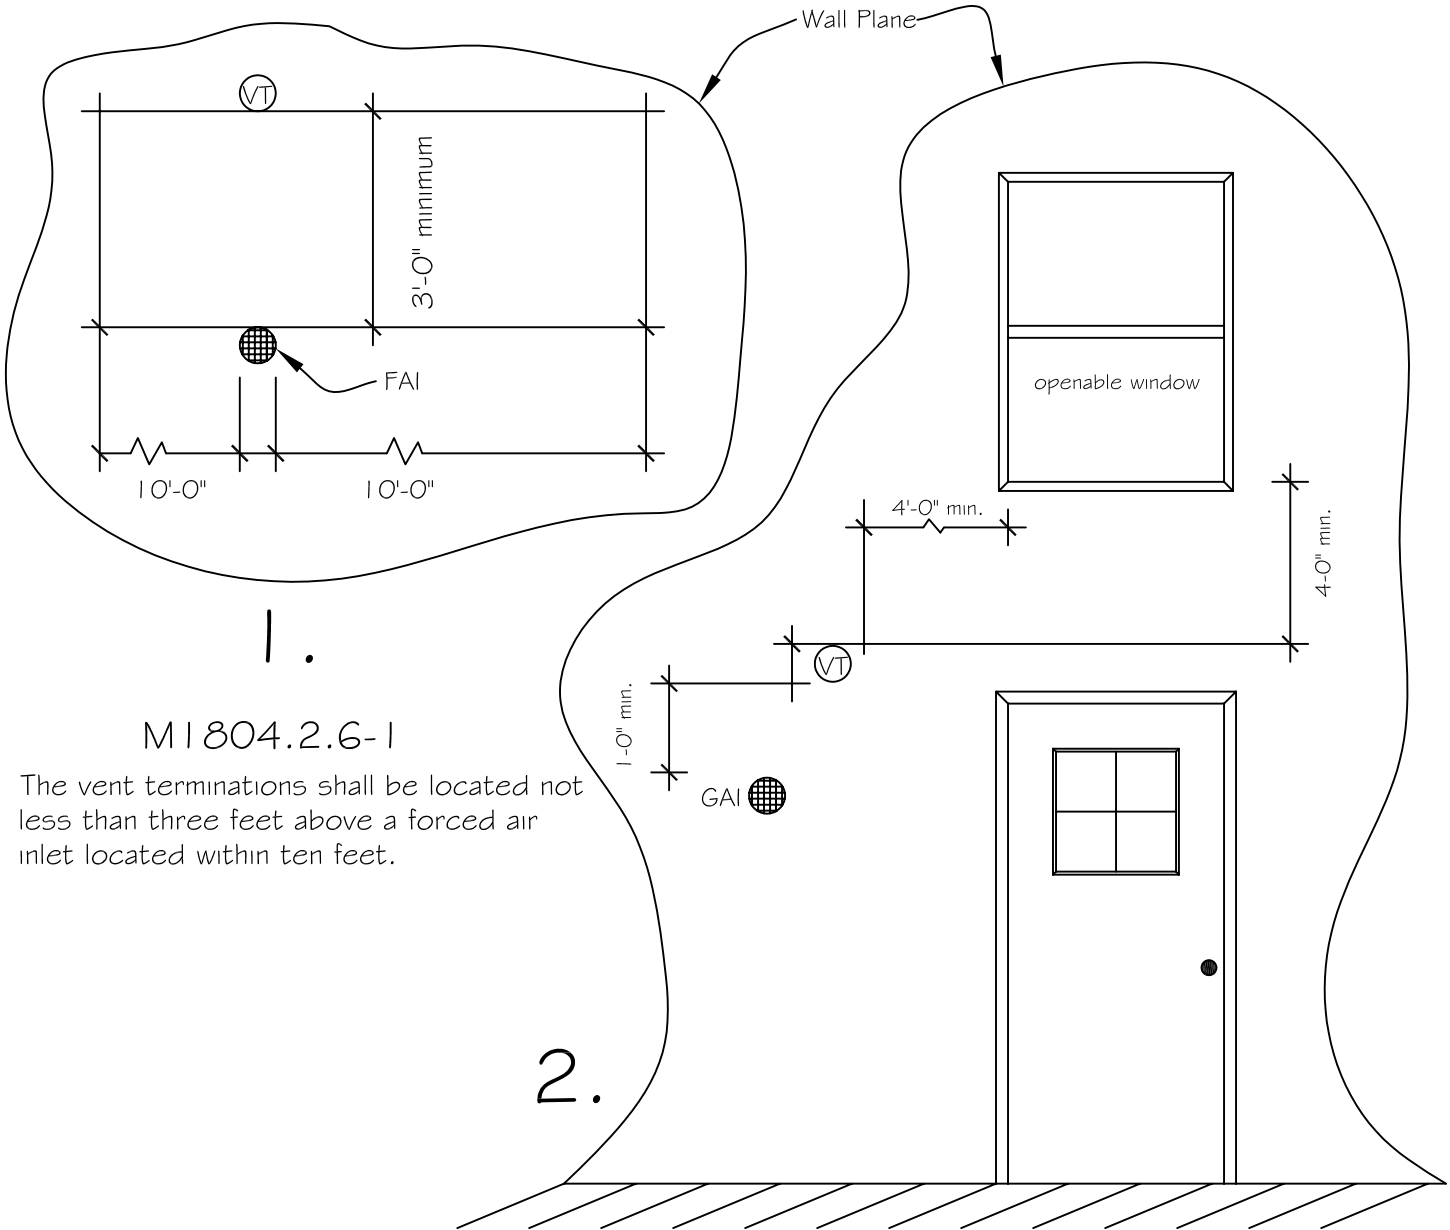

1.

### M1804.2.6-1

The vent terminations shall be located not less than three feet above a forced air inlet located within ten feet.

2.

### M1804.2.6-2

The vent termination shall be located not less than 4' below, 4' horizontally from, or 1' above any door, window or gravity air inlet into a building.

2006 IMC

VT:vent termination  
FAI:forced air inlet  
GAI:Gravity Air Inlet