




Southwest Washington Chapter of ICC

This construction detail is illustrative of the minimum standard of construction based upon the 2009 IRC / WAC 51-51

Visit our web site at: www.sww-icc.org

12'x20' Elevated Deck

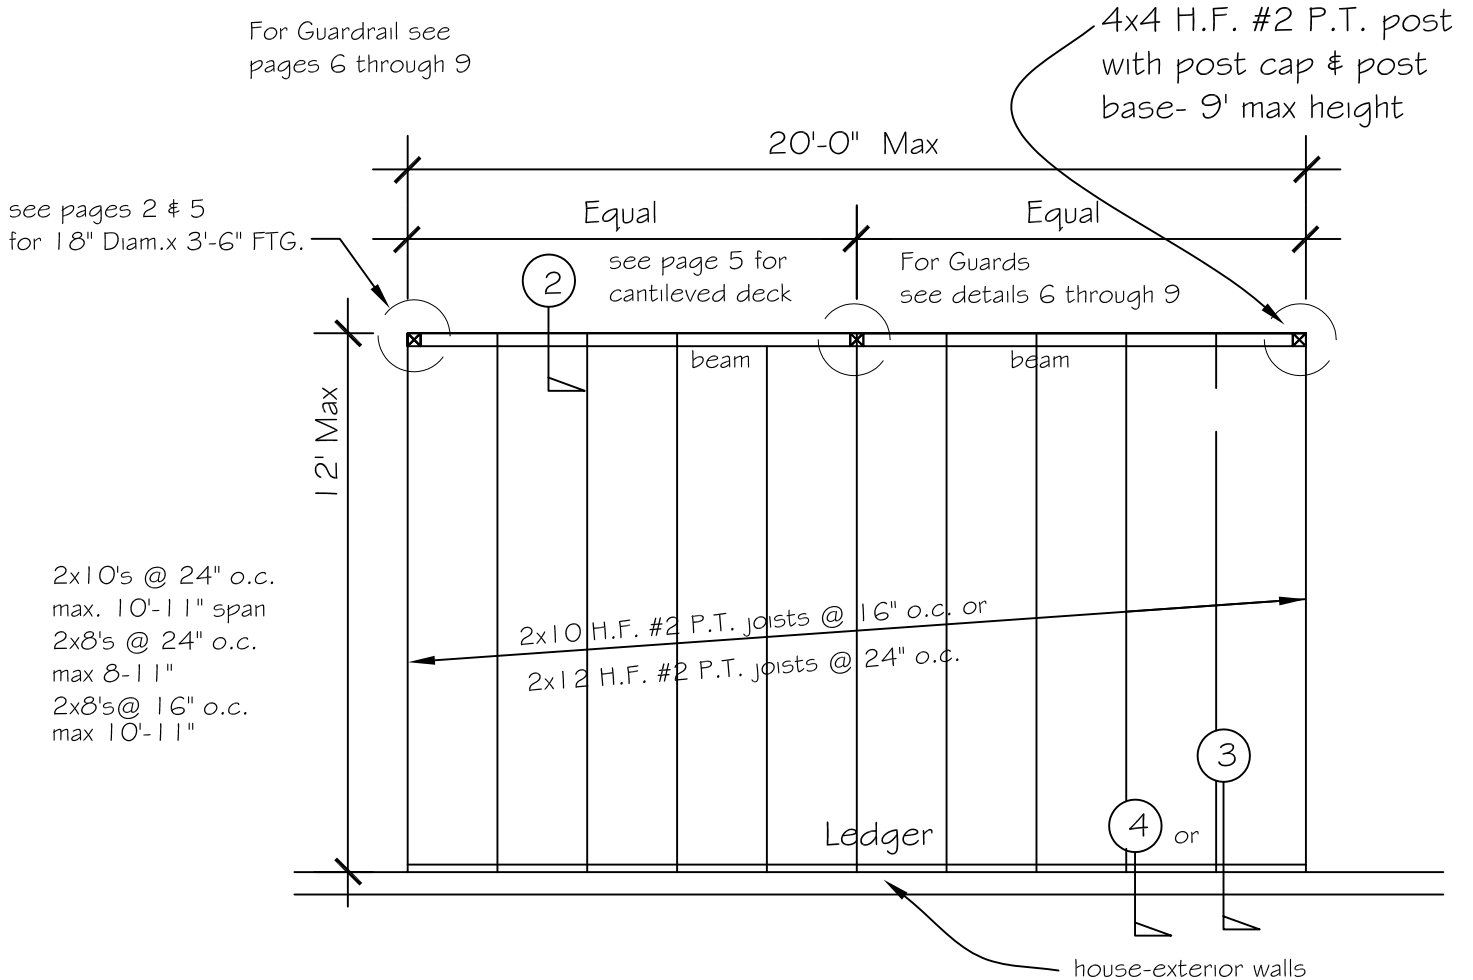


Plan Detail

Beam= 4x10 H.F. #2 P.T. for 9'-4" max span
 4x12 H.F. #2 P.T. for 10' -9" max span

Note:

1. Exterior wood shall be pressure treated or decay resistant per R317.1.
2. Field cuts and holes shall be treated per R317.1.1.
3. All wood in ground contact shall be approved pressure-preservative-treated suitable for ground contact per R317.1.2.
4. Fasteners for PT wood shall be hot dipped galvanized or as per R317.3.



FLOOR PLAN - 12'x 20' Deck(max)