


## TEMPERED GLAZING REQUIREMENTS

### R308.4 Hazardous locations, Item #3:

Glazing in an individual fixed or operable panel, that meet all of the following conditions:

- 3.1 The exposed area of an individual pane is larger than 9 square feet and;
- 3.2 The bottom edge of the glazing is less than 18 inches above the floor and;
- 3.3 The top edge of the glazing is more than 36 inches above the floor and;
- 3.4 One or more walking surfaces are within 36 inches measured horizontally and in a straight line, of the glazing.

EXCEPTION:  
horizontal rail 1 1/2" high  
and able to withstand  
50 #/in.ft. horizontal load  
without contacting glazing

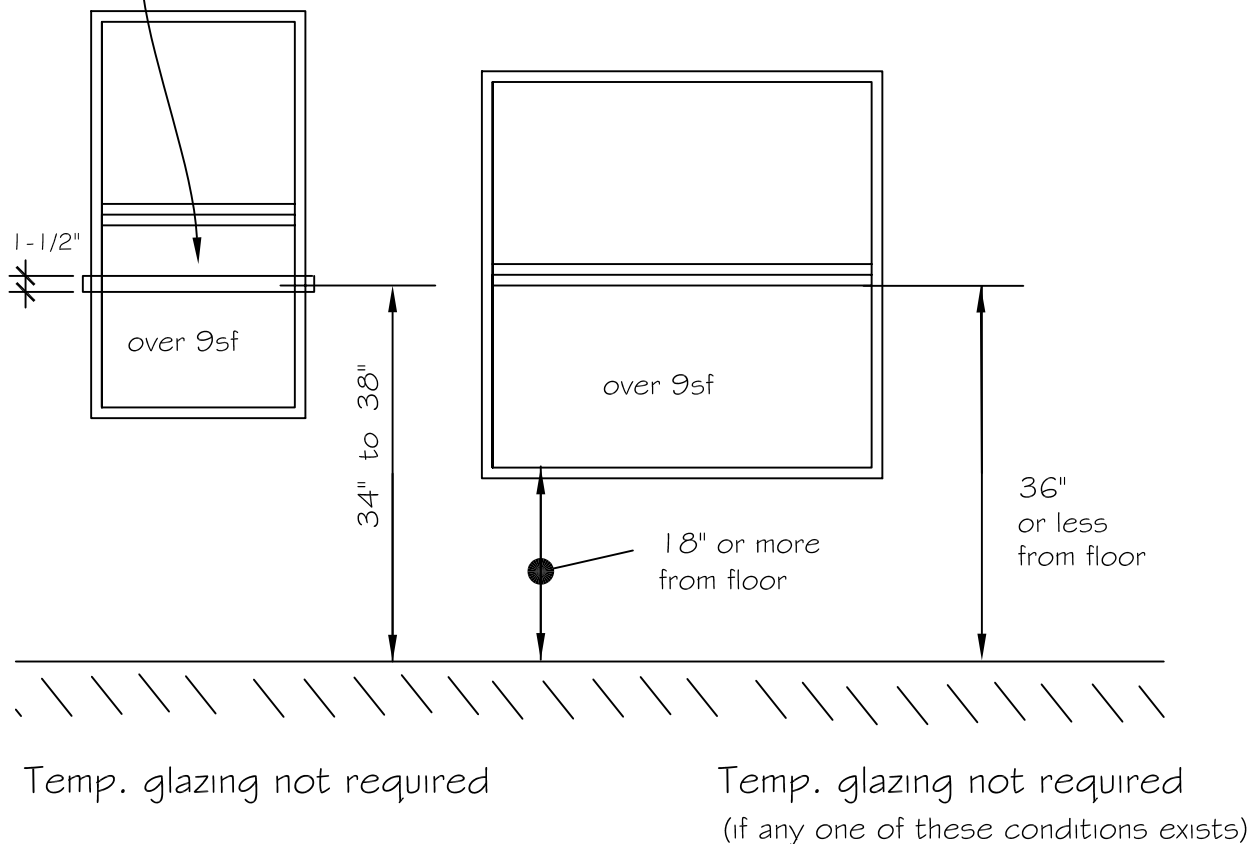

## Tempered Glazing Requirements