Southwest Washington Chapter of ICC

This construction detail is accepted as meeting the minimum standard of construction as based upon the 2004 IBC / WAC 51-50 requirements and is accepted in the following regional jurisdictions

Clark County, Cowlitz County, Skamania County, City of Camas, City of Centralia, City of Kalama City of Longview, City of Ridgefield, City of Vancouver, City of Washougal, City of Woodland

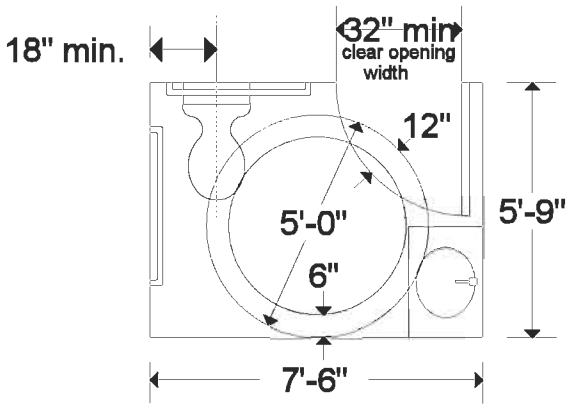

GRAB BAR LOCATIONS FOR TOILET ROOMS

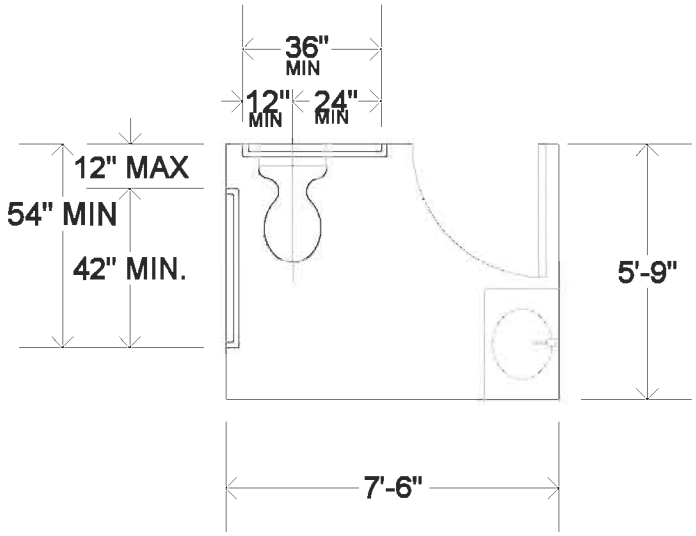

WATER CLOSETS MAY ENCROACH INTO THE 5' DIAMETER CLEAR FLOOR AREA NOT MORE THAN 6"

LAVATORY MAY PROJECT 19" WITH PROPER KNEE CLEARANCE WAC 1106.11.7.1

DOOR SWING MAY ENCROACH A MAXIMUM 12" (INCHES) INTO THE 5' (FOOT) DIAMETER CLEAR FLOOR SPACE

PLAN VIEW

ELEVATION VIEW

MOUNT FLUSH LEVER ON SIDE AWAY FROM WALL A MINIMUM OF 36"-44" ABOVE FINISH FLOOR

SINK CONTROLS SHALL BE THE LEVER TYPE

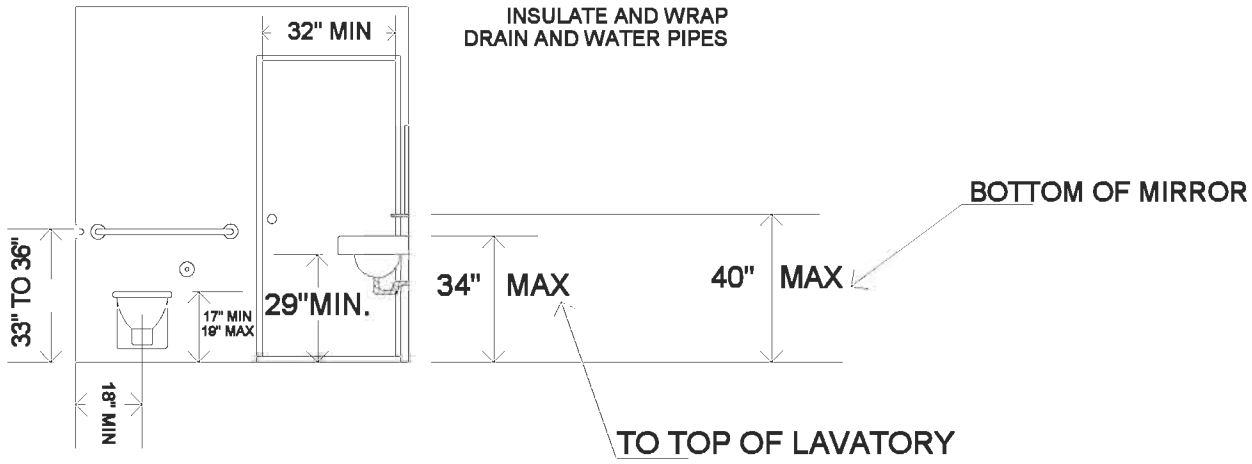

FIXTURE HEIGHT
Per WAC 1106.11

NOTE! ROOM DIMENSIONS MAY VARY DEPENDING ON DESIGN

#9 1/1/00

ACCESSIBLE REST ROOMS #1

DWG BY LGN