




Southwest Washington Chapter of ICC

This construction detail is illustrative of the minimum standard of construction based upon the 2003 IRC / WAC 51-51

12'x20' Elevated Deck

NOTE: All exposed lumber to be pressure treated (P.T.) or decay resistant. Fasteners for P.T. wood shall be hot-dipped galv. or stainless steel

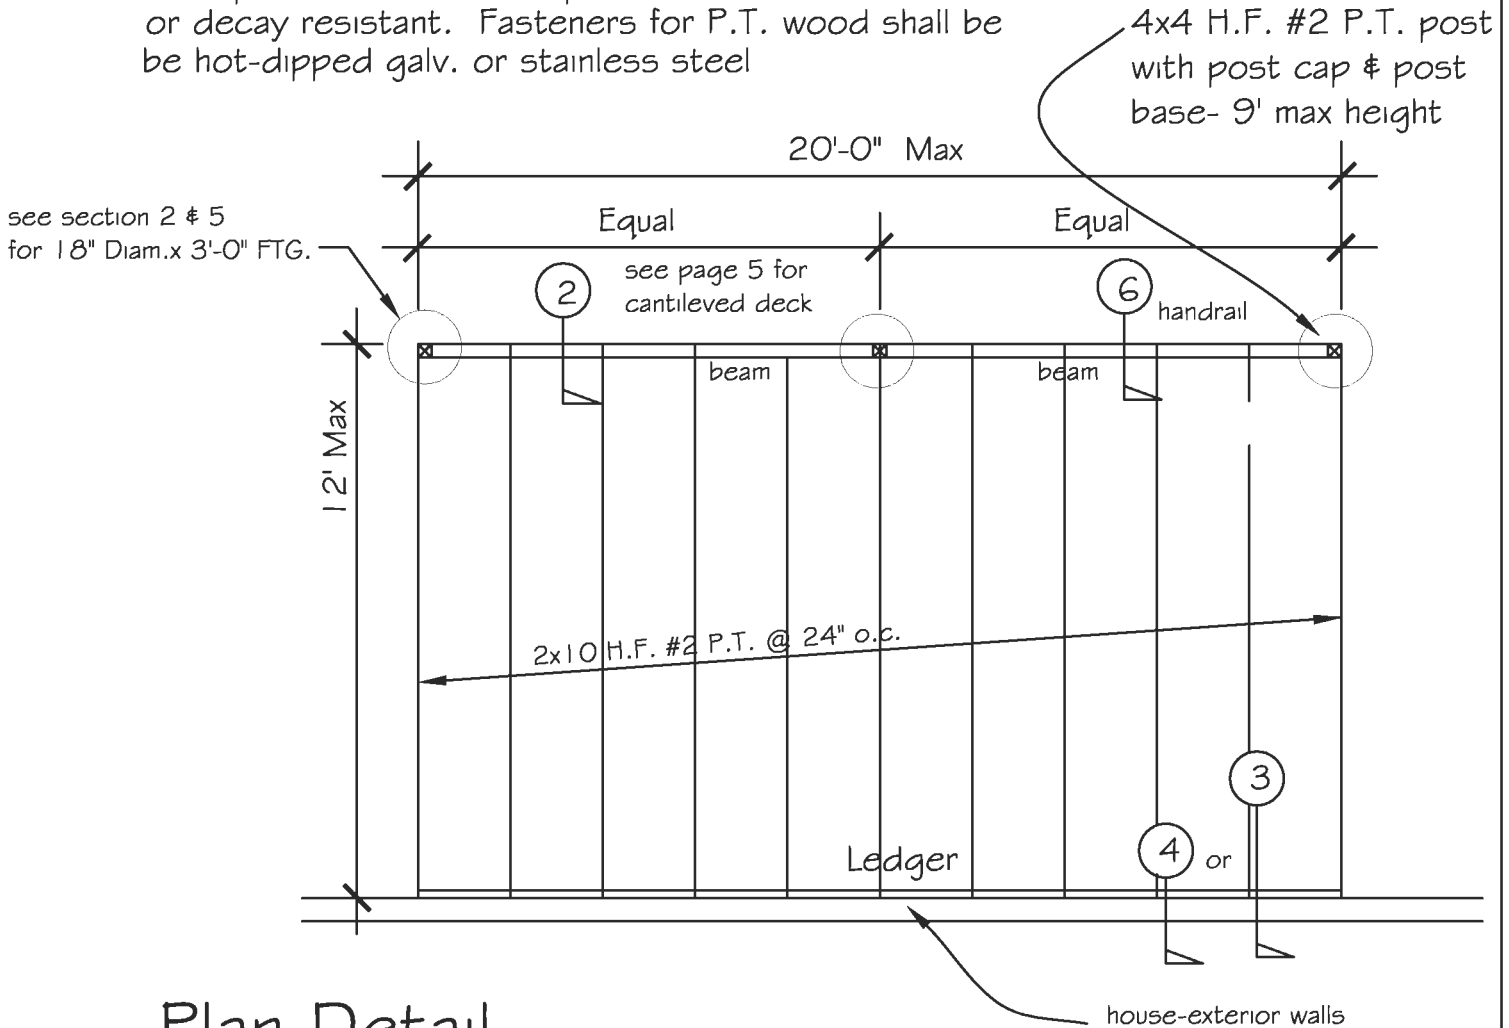


Plan Detail

Beam= 4x10 H.F. #2 P.T. for 8' max span
4x12 H.F. #2 P.T. for 10' max span

Note:

1. Fasteners for pressure preservative treated wood(ACQ) shall be Hot dipped galvanized or as per IRC Section R319.3.
2. Exterior wood shall be pressure treated or decay resistant per R319.1.
3. All wood in contact with ground shall be approved pressure preservative treated wood suitable for ground contact. R319.1.1.



FLOOR PLAN - 12'x 20' Deck(max)

scale- 1/4" = 1'-0"