




# Southwest Washington Chapter of ICC

This construction detail is illustrative of the minimum standard of construction based upon the 2003 IRC / WAC 51-51

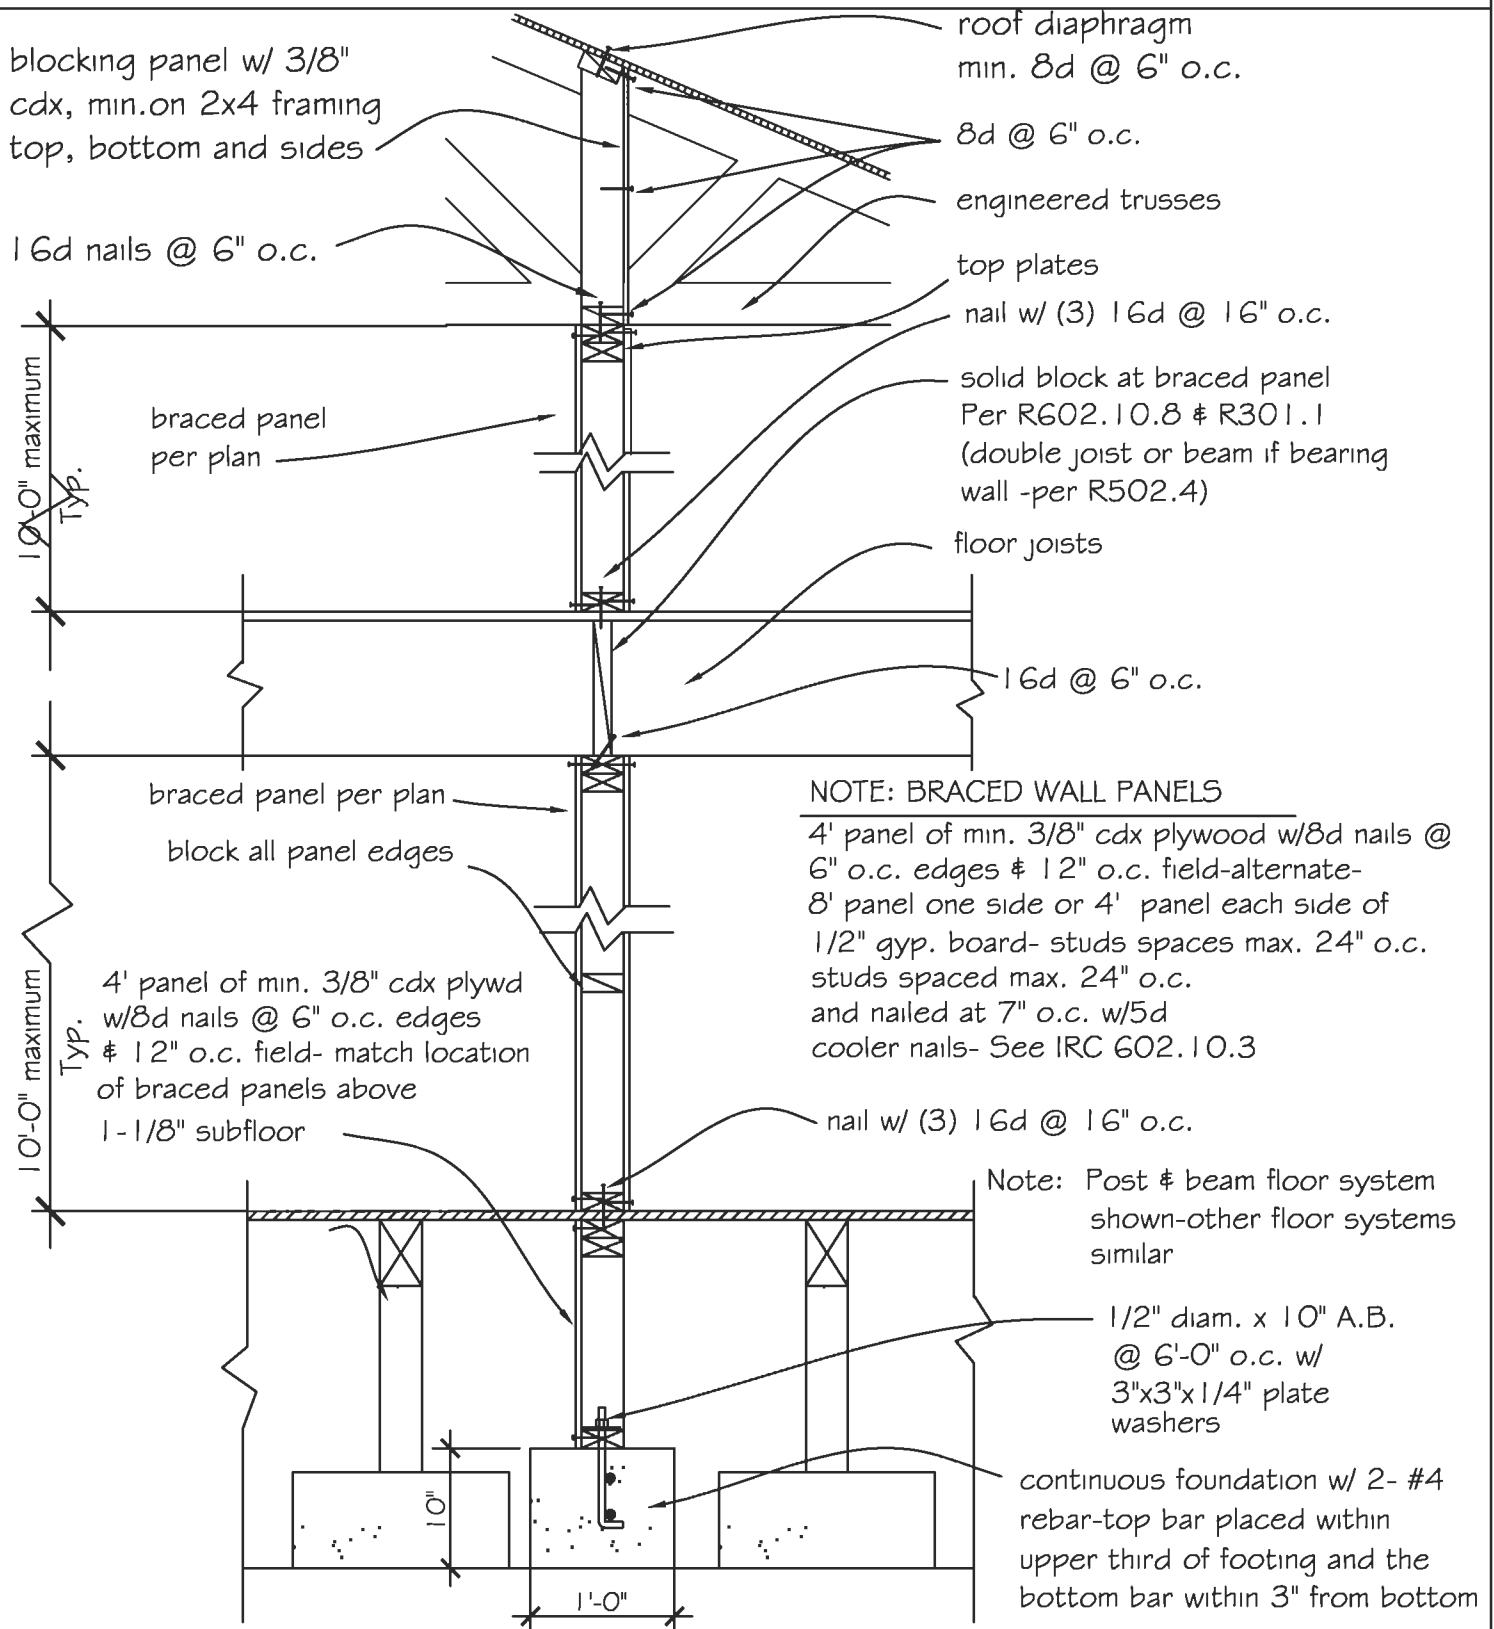

**NOTE: BRACED WALL PANELS**  
 4' panel of min. 3/8" cdx plywood w/ 8d nails @ 6" o.c. edges & 12" o.c. field-alternate- 8' panel one side or 4' panel each side of 1/2" gyp. board- studs spaces max. 24" o.c. studs spaced max. 24" o.c. and nailed at 7" o.c. w/ 5d cooler nails- See IRC 602.10.3

Interior Braced Wall Panels (w/trusses or rafters perpendicular to panels)