




Southwest Washington Chapter of ICC

This construction detail is accepted as meeting the minimum standard of construction as based upon the 2003 IRC / WAC 51-51 requirements and is accepted in the following regional jurisdictions

Cities of; Camas, Centralia, Kalama, Ridgefield, Castle Rock, Vancouver, Washougal, Winlock, Woodland, Longview, Battle Ground,
Counties of; Clark, Cowlitz, Skamania, Lewis

R309.1 Openings from a private garage directly into a room used for sleeping purposes shall not be permitted. Other openings between the garage and residence shall be equipped with solid wood doors not less than 1-3/8" in thickness, solid or honeycomb core steel doors not less than 1-3/8 inches thick or 20 minute fire-rated doors.

R309.2 The garage shall be separated from the residence and its attic area by not less than 1/2 inch gypsum board applied to the garage side. Garages beneath habitable rooms shall be separated from all habitable rooms above by not less than 5/8 inch Type X gypsum board or equivalent. Where the separation is a floor-ceiling assembly, the structure supporting the separation shall also be protected by not less than 1/2 inch gypsum board or equivalent.

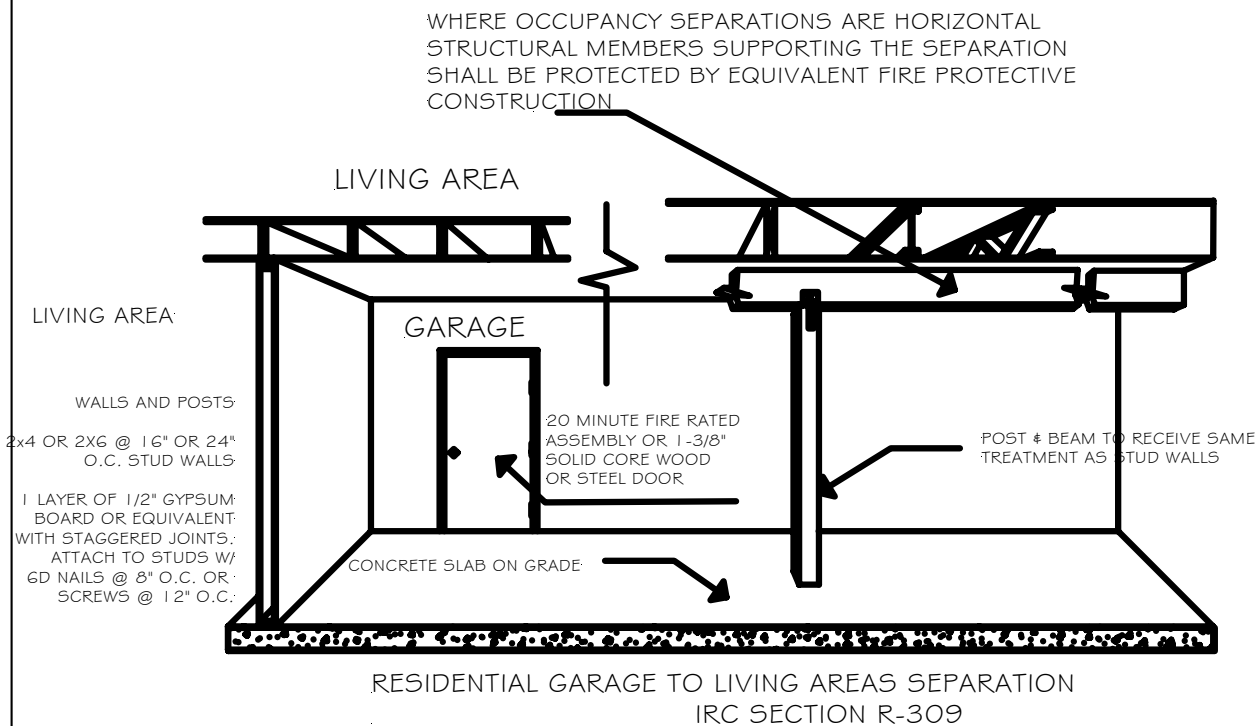

NOTE;
 ALL FASTENERS MUST BE GYP. BD. TYPE AND FASTENED TO JOIST OR STUDS UNLESS OTHERWISE NOTED
 ALL SCREWS MUST BE 1-1/4" LONG GYP. BD. TYPE W UNLESS OTHERWISE NOTED.

R309 2/04