



## Typical Landing, Stairs, and Railing

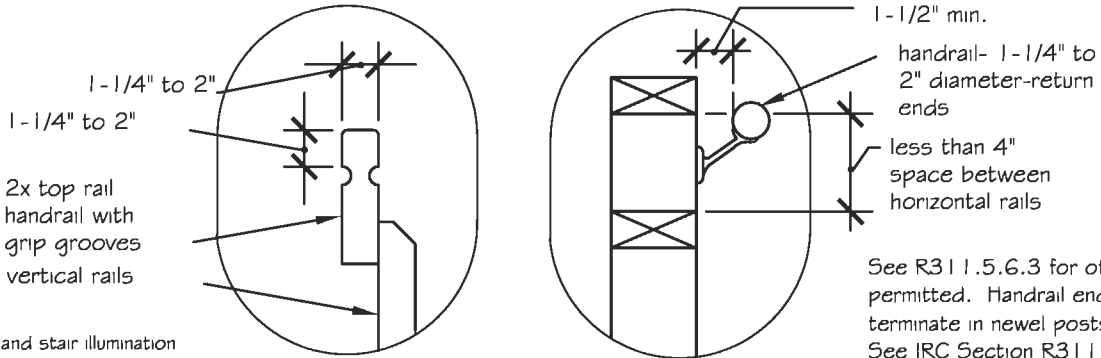

\* Landing and stair illumination is required per R303.6

(A) Stair handrail (B) Stair handrail

- minimum 3'x3' landing at all exterior doors
- min. 36" wide stairway

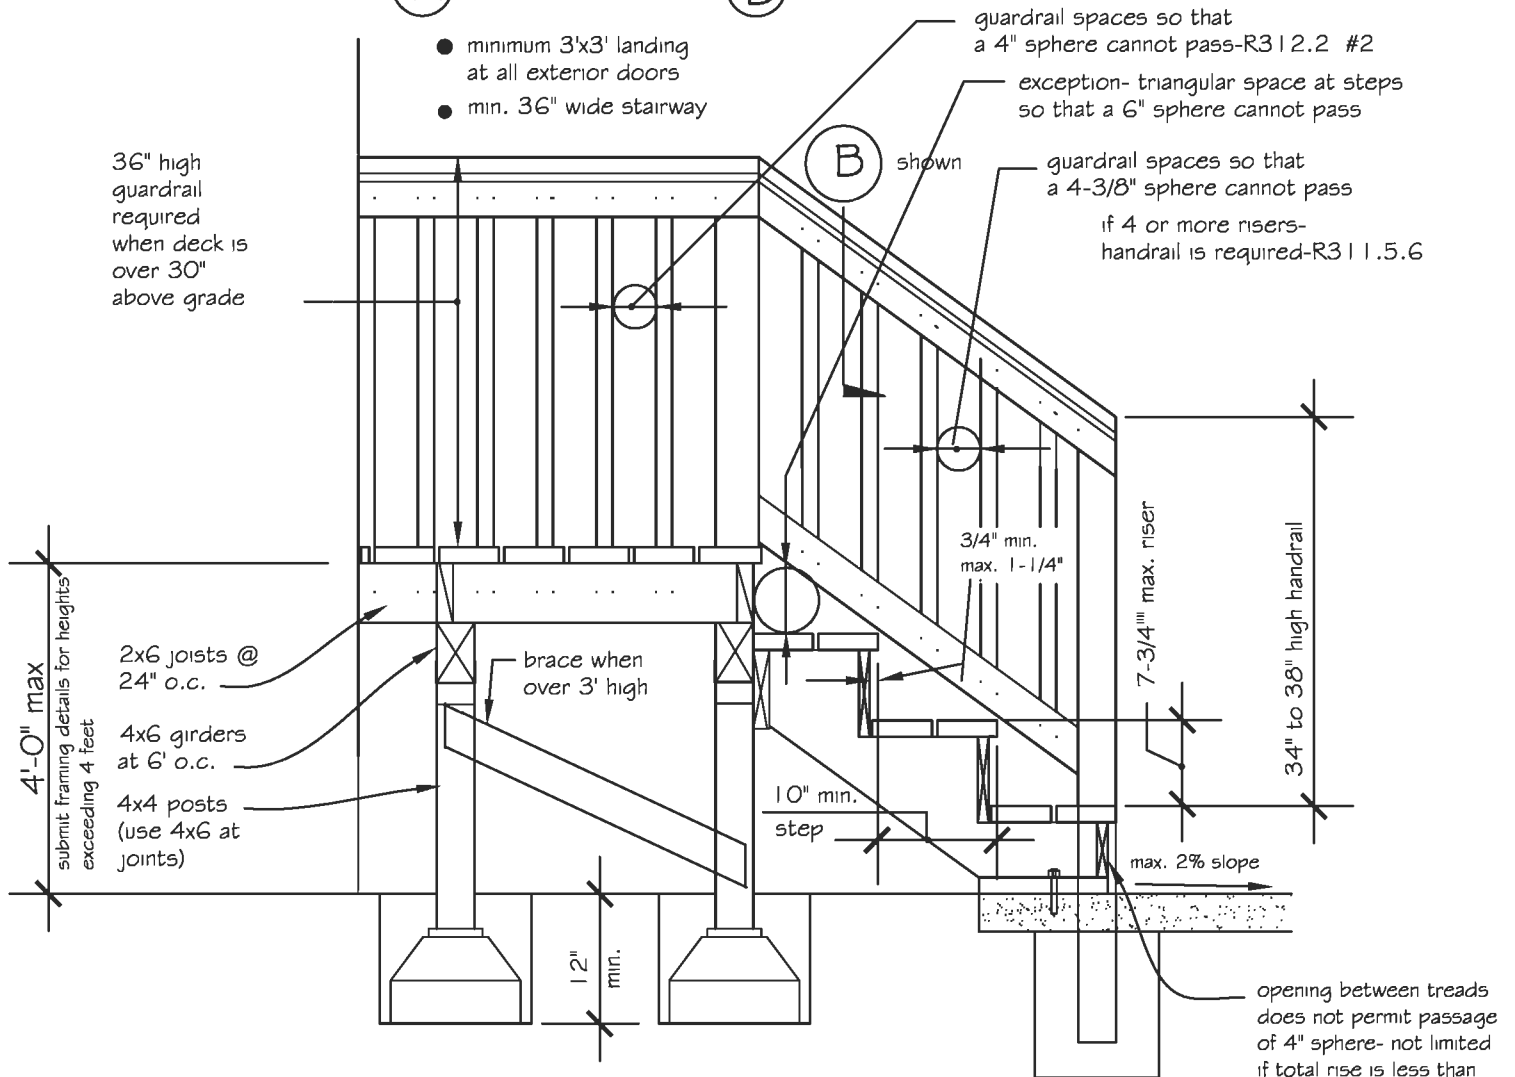

All exterior landing and components exposed to the weather must utilize decay-resistant wood such as heartwood of redwood, black locust, cedars or pressure-treated wood in accordance with International Residential Code Section R319.1.