


### M1804.2.6 (3)

The vent termination point shall not be located closer than 3'-0" to an interior corner formed by two walls perpendicular to each other.

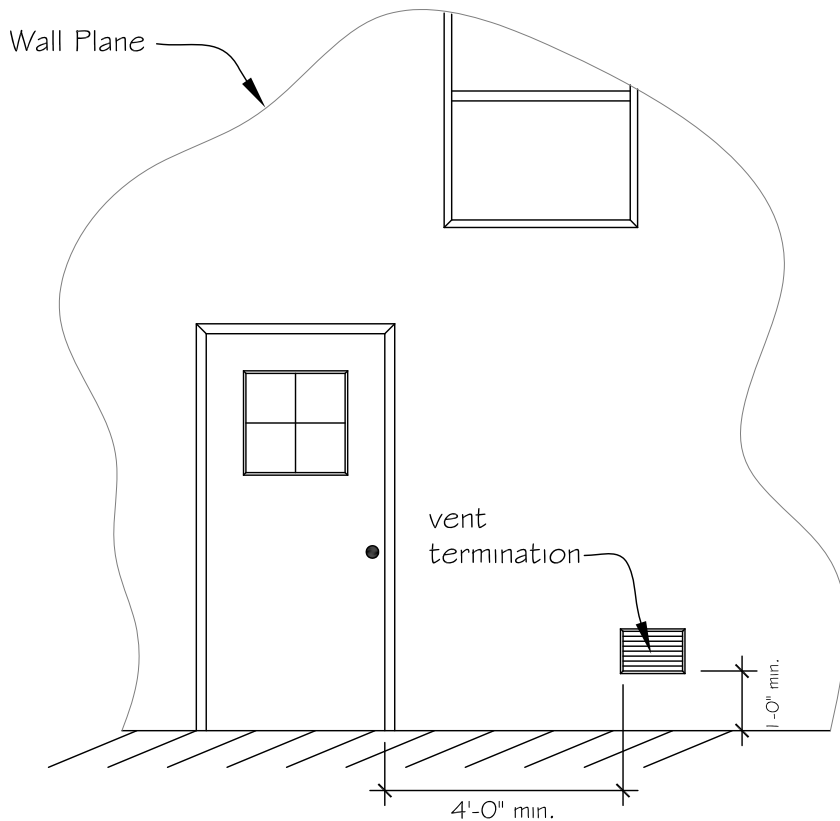

### M1804.2.6 (4)

The bottom of the vent termination shall be located at least 12" above finish grade level

### M1804.2.6 (5)

The vent termination shall not be mounted directly above or within 3'-0" horizontally of an oil tank vent or gas meter.  
Also, contact the local gas purveyor

### M1804.2.6 (6)

Power exhauster termination shall be not less than 10'-0" from the lot line and adjacent buildings.

### M1804.2.6 (7)

The discharge shall be directed away from the building.