


M1804.2.6 Mechanical draft systems

Mechanical draft systems shall comply with UL 378 and shall be installed in accordance with their listing, the manufacturer's instructions and, except for the direct-vent appliances. See the following illustrations for the requirements.

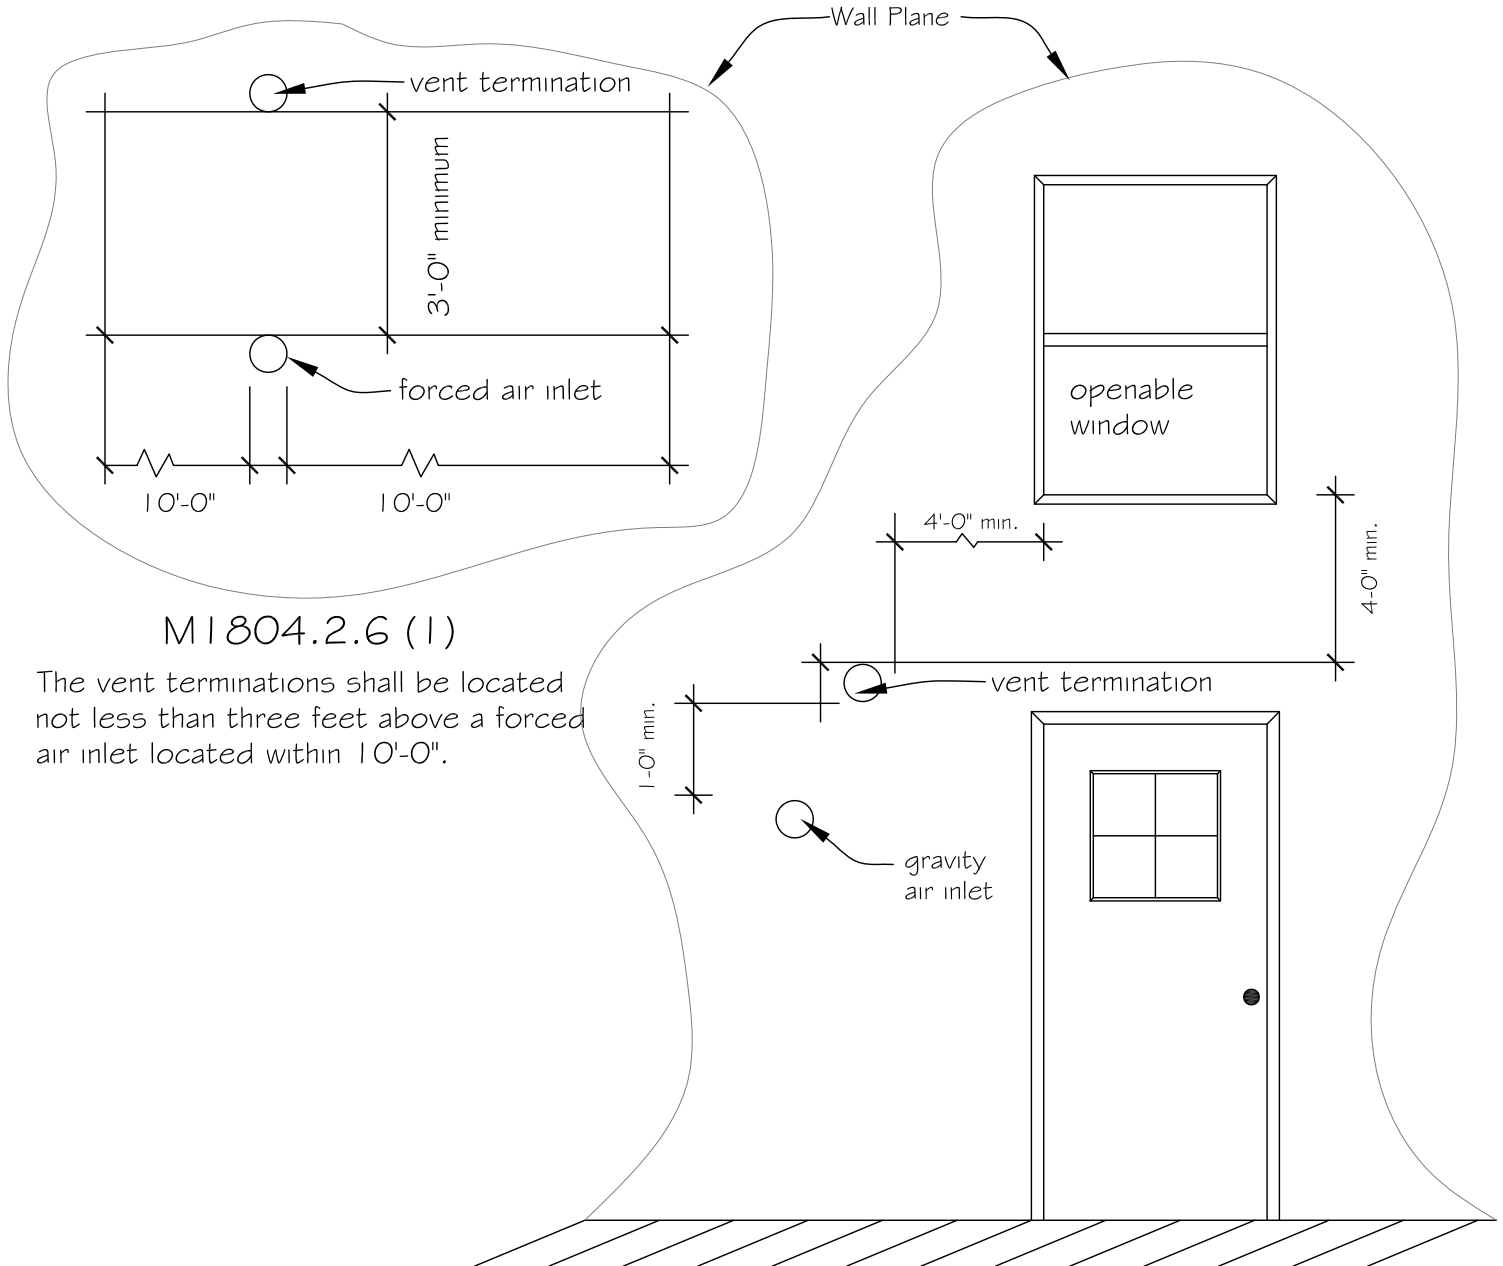

M1804.2.6 (1)

The vent terminations shall be located not less than three feet above a forced air inlet located within 10'-0".

M1804.2.6 (2)

The vent termination shall be located not less than 4'-0" below, 4'-0" horizontally from, or 1'-0" above any door, window or gravity air inlet into a dwelling