




Southwest Washington Chapter of ICC


This construction detail is illustrative of the minimum standard of construction based upon the 2015 IRC / WAC 51-51

Visit our web site at: www.sww-icc.org

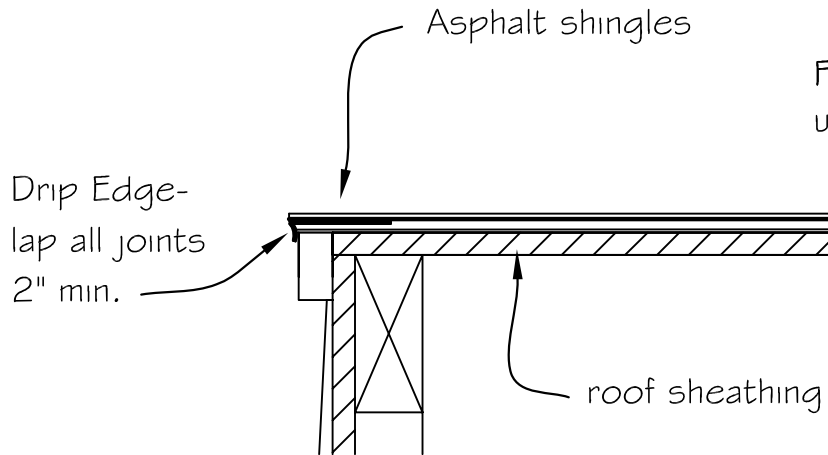

Note: Drip edge to be mechanically fastened to the roof deck @ max 12" o.c. w/ 12 ga. roofing nailing w/min 3/8" head See IRC 905.2.5.

Section at gable or rake

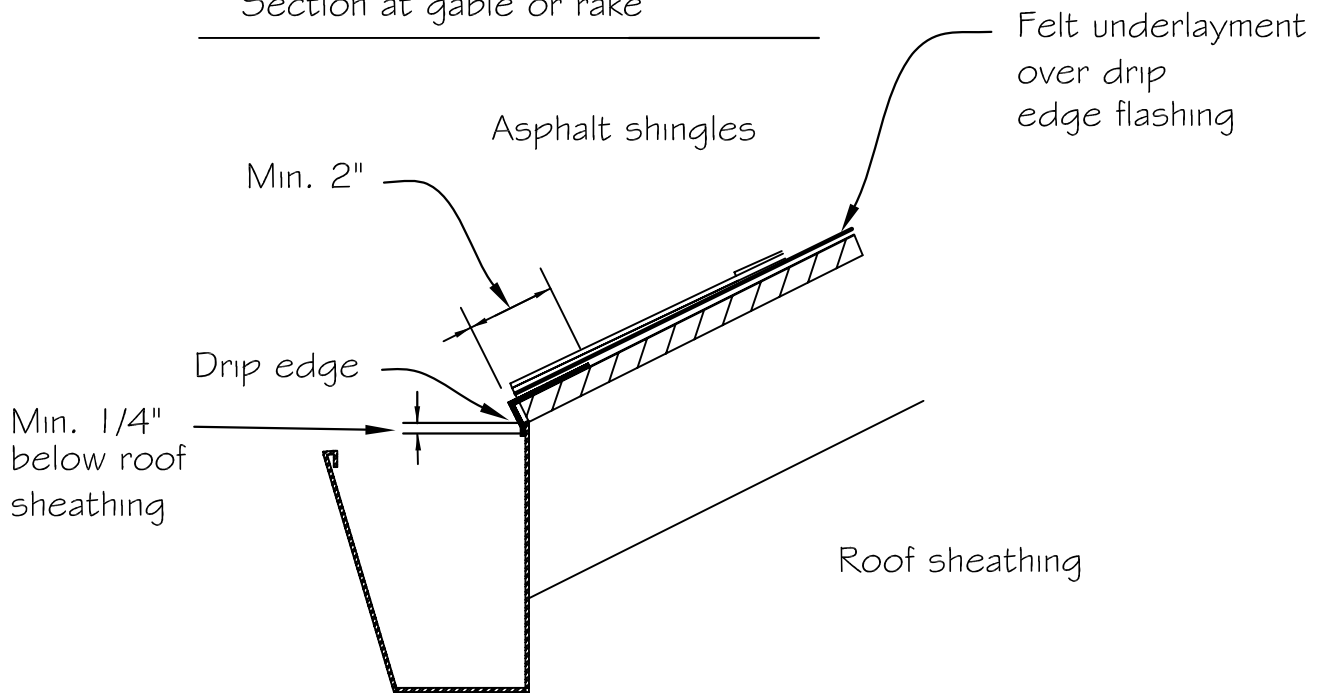

Section at eave